


MITSUBISHI ELECTRIC CORPORATION

|                  |             |                      |     |   |          |
|------------------|-------------|----------------------|-----|---|----------|
| APPLICATION NOTE | Prepared by | S.Uchida             | Rev | A | M. Kawan |
|                  | Approved by | M.Tabata 27-Nov.-'02 |     |   |          |

CMH5168a.doc

Recovery Loss vs. IE  
(typical)  
CM300DY-24NF

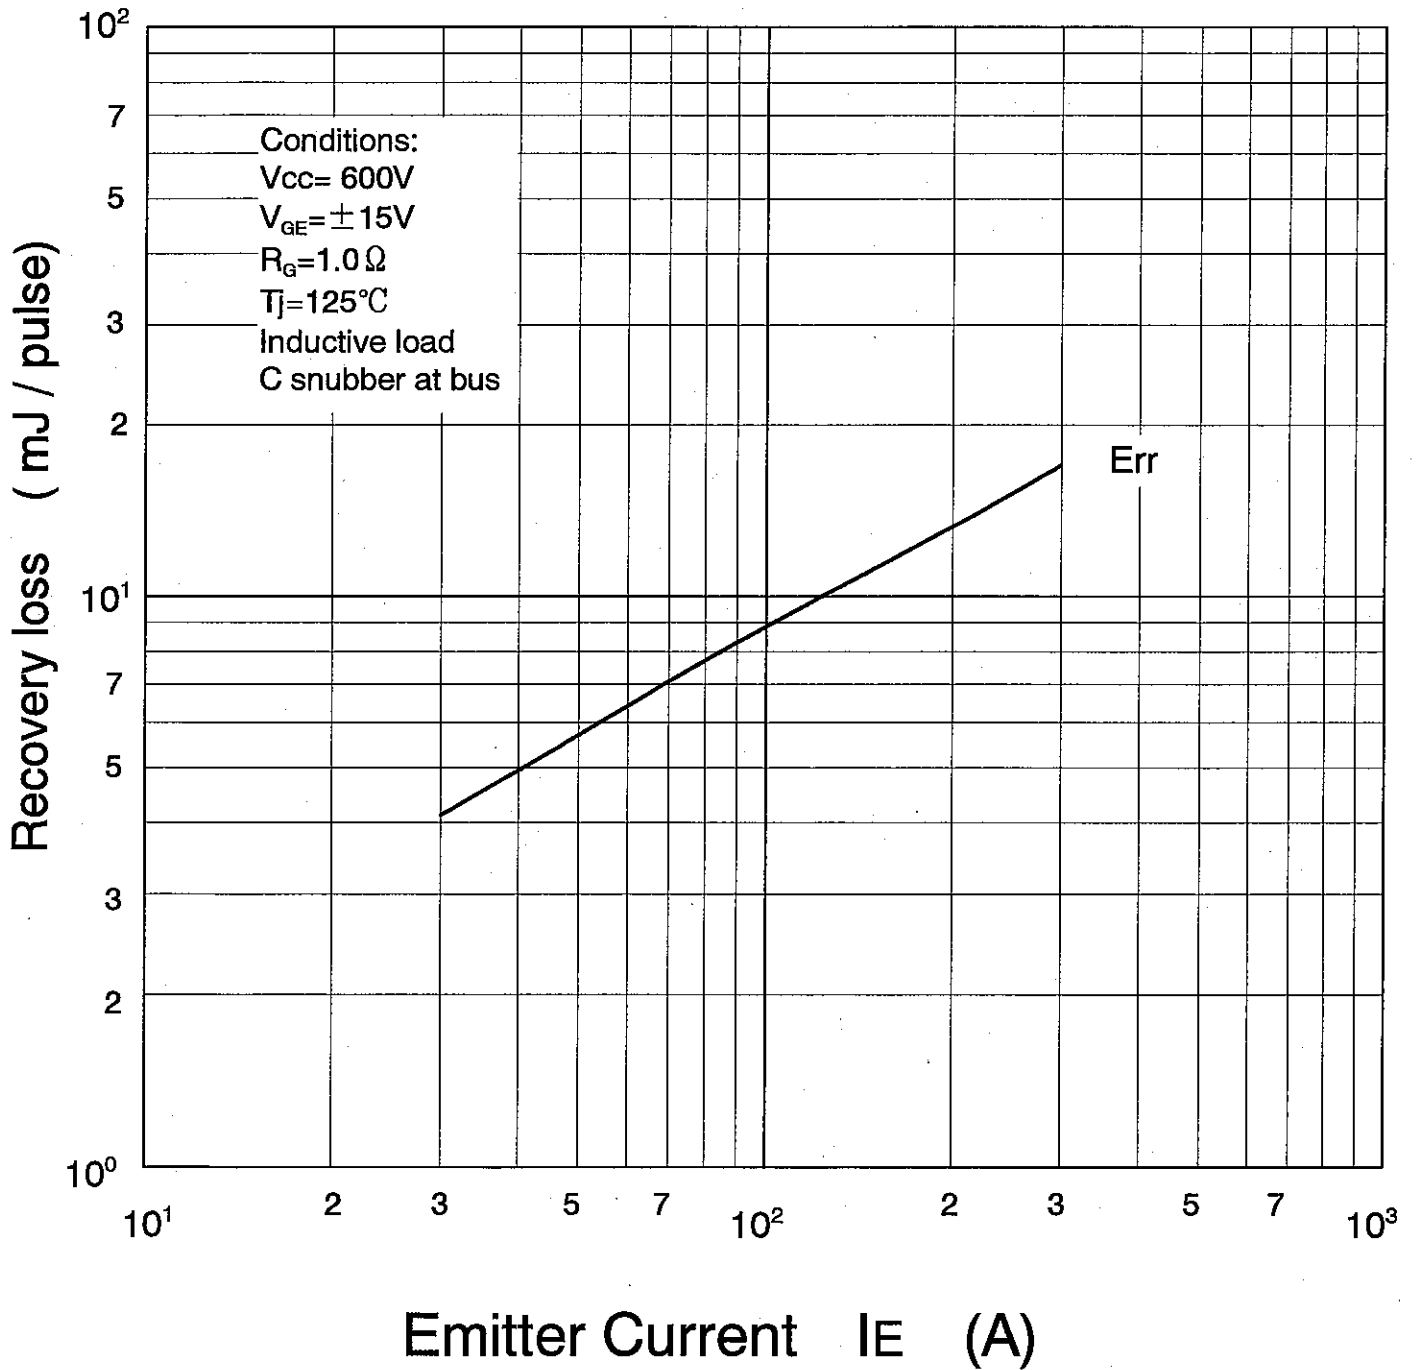

MITSUBISHI ELECTRIC CORPORATION

|                  |             |  |     |  |
|------------------|-------------|--|-----|--|
| APPLICATION NOTE | Prepared by |  | Rev |  |
|                  | Approved by |  |     |  |

Recovery Loss vs. Gate Resistance  
(typical)  
CM300DY-24NF

